



Test Report: HBG-100-48

100W Constant Current Mode LED Driver

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test



■ RELIABILITY TEST

Environment Test

DESIGN VERIFY TEST

OUTPUT FUNCTION TEST



| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|--|-------------------------------|--|------------------------------|
| 1 | CONSTANT CURRENT REGION | 28.8V~48V | I/P: 230VAC O/P: LED MODE Ta: 25°C | 28.8V~48V |
| 2 | OUTPUT CURRENT ADJUST RANGE (For A-Type only) | 1.2A~2.0A | I/P: 230VAC O/P: SETTING Ta: 25°C | 1.1 A~ 2.1 A |
| 3 | CURRENT RIPPLE | 5.0% max.@rated current | I/P: 230VAC O/P: FULL/MIN LOAD Ta: 25°C | 2.31% |
| 4 | CURRENT TOLERANCE | <±5.0% | I/P: 230VAC O/P: FULL/MIN LOAD Ta: 25°C | <5% |
| 5 | OPEN CIRCUIT VOLTAGE (max) | 49V | I/P: 230VAC O/P: NO LOAD Ta: 25°C | 48.6V |
| 6 | SET UP TIME | 500ms/230VAC 2000ms/115VAC | I/P: 230 VAC I/P: 115 VAC O/P: FULL LOAD Ta: 25°C | 396ms/230VAC 254ms/115VAC |

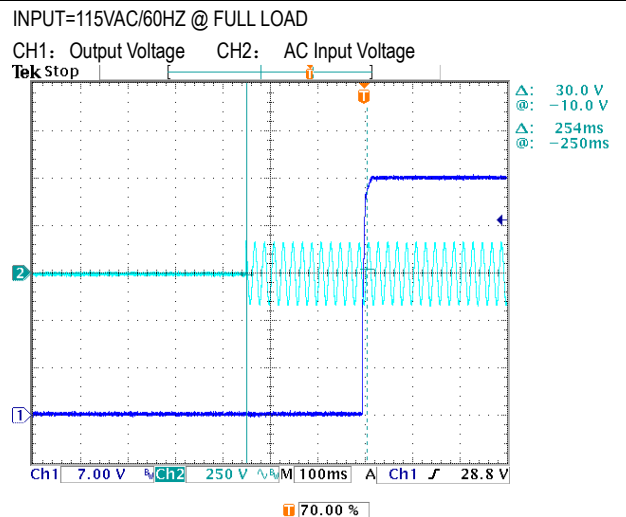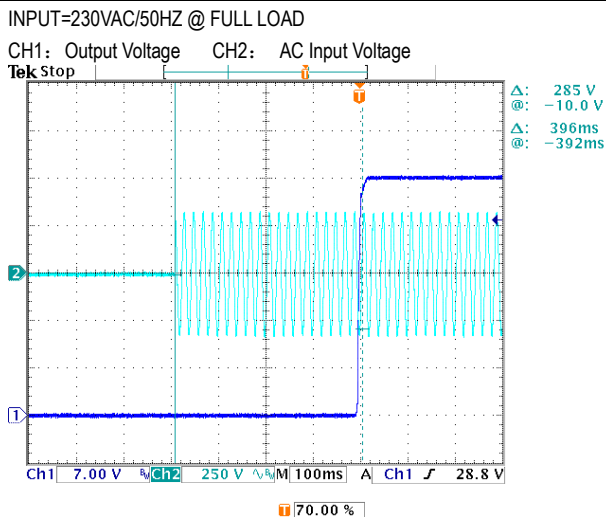



7 DIMMING OPERATION (for B-Type)

- Output constant current level can be adjusted by applying one of the three methodologies between DIM+ and DIM-: 0 ~ 10Vdc, or 10V PWM signal or resistance.
- Direct connecting to LEDs is suggested. It is not suitable to be used with additional drivers.
- Dimming source current from power supply: 100uA (typ.)



◎ Applying additive 0 ~ 10VDC

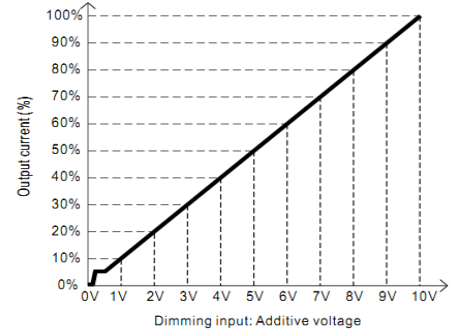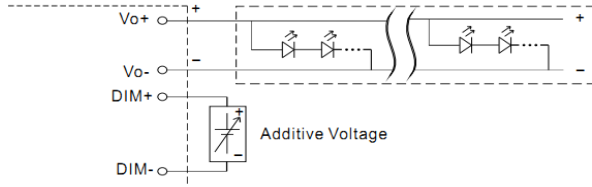

◎ Applying additive 10V PWM signal (frequency range 100Hz ~ 3KHz):

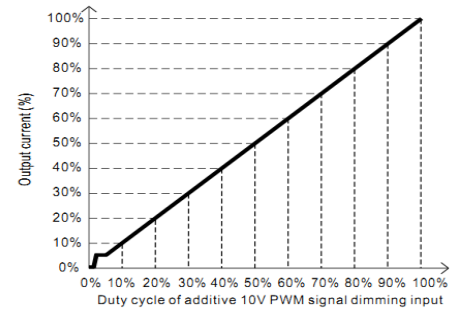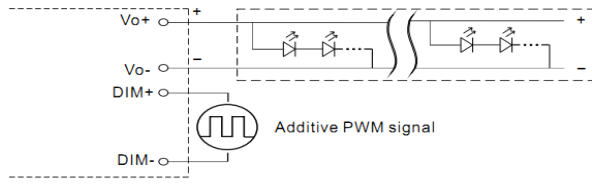

◎ Applying additive resistance:

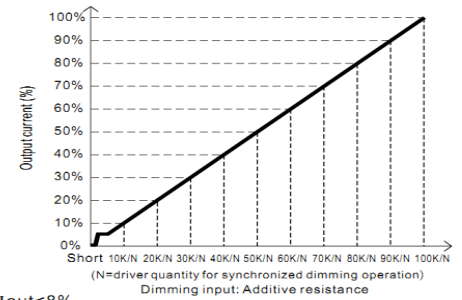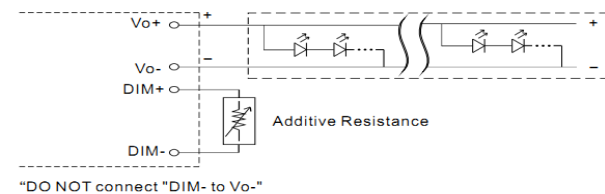

Note : 1. Min. dimming level is about 8% and the output current is not defined when $0\% < I_{out} < 8\%$.
 2. The output current could drop down to 0% when dimming input is about $0k\Omega$ or 0Vdc, or 10V PWM signal with 0% duty cycle.

I/P: 230 VAC

O/P: DIMMING TEST

Ta: 25°C

| | V | Short | 1V | 2V | 3V | 4V | 5V | 6V | 7V | 8V | 9V | 10V |
|---|----------------|-------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| 1 | Output Current | 0 | 0.294A | 0.570A | 0.842A | 1.118A | 1.395A | 1.669A | 1.943A | 2.223A | 2.497A | 2.727A |
| | % | 0% | 10.89% | 21.11% | 31.19% | 41.41% | 51.67% | 61.81% | 71.96% | 82.33% | 92.48% | 101.0% |
| 2 | PWM(100Hz) | 0V | 10% | 20% | 30% | 40% | 50% | 60% | 70% | 80% | 90% | 100% |
| | Output Current | 0 | 0.316A | 0.584A | 0.853A | 1.121A | 1.392A | 1.660A | 1.928A | 2.198A | 2.465A | 2.707A |
| | % | 0% | 11.70% | 21.63% | 31.59% | 41.52% | 51.56% | 61.48% | 71.41% | 81.41% | 91.30% | 100.3% |
| 3 | R | 0% | 10K | 20K | 30K | 40K | 50K | 60K | 70K | 80K | 90K | 100K |
| | Output Current | 0 | 0.281A | 0.542A | 0.801A | 1.062A | 1.322A | 1.582A | 1.842A | 2.100A | 2.359A | 2.618A |
| | % | 0% | 10.41% | 20.07% | 29.67% | 39.33% | 48.96% | 58.59% | 68.22% | 77.78% | 87.37% | 96.96% |

TEST RESULT: OK


| | | |
|---|---|--|
| 8 | DIMMING OPERATION (primary side;for DA-Type) | <p>※DALI Interface</p> <ul style="list-style-type: none"> ·Apply DALI signal between DA+ and DA-. ·DALI protocol comprises 16 groups and 64 addresses. ·First step is fixed at 8% of output. <p>I/P: 230 VAC O/P: DIMMING TEST Ta: 25°C TEST RESULT: OK</p> |
|---|---|--|

INPUT FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------|--|---|---|
| 1 | INPUT VOLTAGE RANGE | 90VAC~305VAC | I/P: TESTING O/P: FULL LOAD Ta: 25°C | 87V~305V |
| | | | I/P: (1)LOW-LINE-3V=87 V HIGH-LINE+10V=315 V O/P: FULL/MIN LOAD ON: 30 Sec OFF: 30 Sec 10MIN (2)230VAC ON: 0.5 Sec OFF: 0.5 Sec 20MIN (POWER ON/OFF NO DAMAGE) | TEST: OK |
| 2 | INPUT FREQUENCY RANGE | 47HZ ~63 HZ NO DAMAGE | I/P: 100 VAC ~305 VAC O/P: FULL~MIN LOAD Ta: 25°C | TEST: OK |
| 3 | AC CURRENT | 1.1A/115VAC 0.5A/230VAC 0.45A/277VAC | I/P: 115 VAC I/P: 230 VAC I/P: 277 VAC O/P: FULL LOAD/75% LOAD Ta: 25°C | I =0.958A/ 115VAC I =0.474A/ 230VAC I =0.397A/ 277VAC |
| 4 | LEAKAGE CURRENT | < 0.75mA / 277VAC | I/P: 277 VAC O/P: NO LOAD Ta: 25°C | L-FG: 0.600 mA N-FG: 0.596 mA |
| 5 | INRUSH CURRENT(Typ) | 60A/230VAC Twidth =550us measured at 50% Ipeak COLD START | I/P: 230 VAC O/P: FULL LOAD Ta: 25°C | I =45.0A/ 230VAC Twidth =488 us |


INPUT=230VAC/50HZ @ FULL LOAD

CH2: Input current CH1: AC Input Voltage

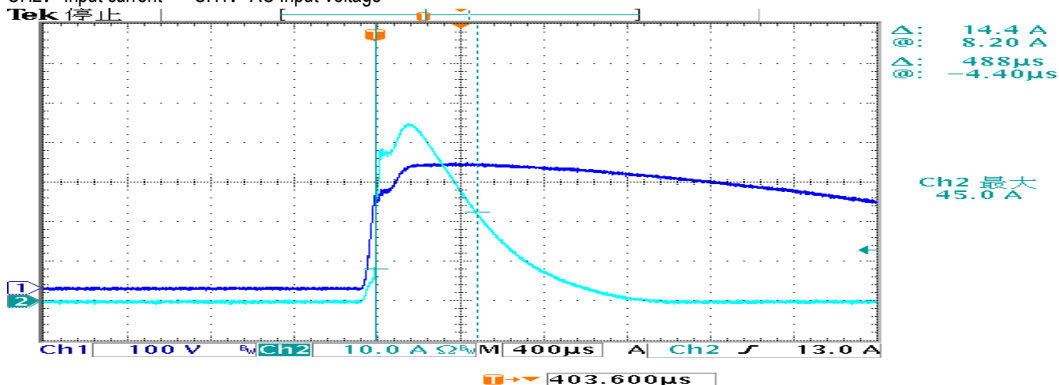


| | | | | |
|---|-----------------|-----|---|--------|
| 6 | EFFICIENCY(Typ) | 91% | I/P: 230VAC O/P: FULL LOAD Ta: 25°C | 91.23% |
|---|-----------------|-----|---|--------|

EFFICIENCY vs LOAD

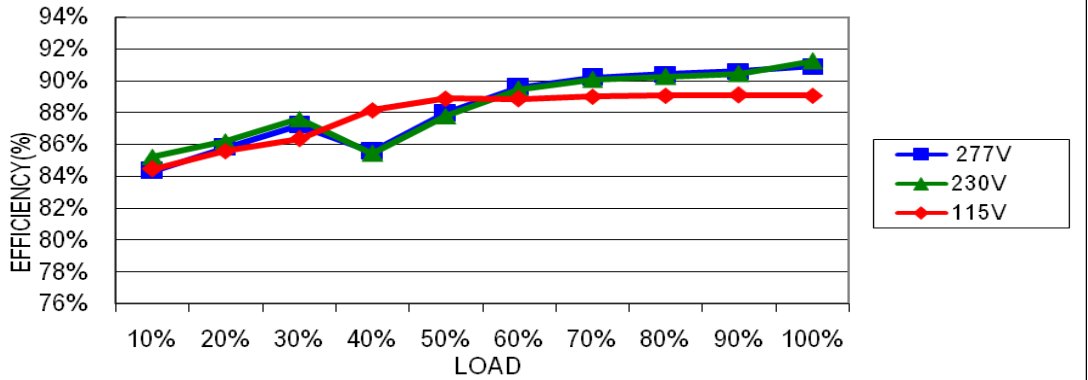


| | | | | |
|---|--------------|--|--|--|
| 7 | POWER FACTOR | 0.96/ 115VAC 0.96/ 230VAC 0.94/ 277VAC | I/P: 115 VAC I/P: 230 VAC I/P: 277 VAC O/P: FULL LOAD Ta: 25°C | PF=0.994 /115VAC PF=0.983 /230VAC PF=0.969 /277VAC |
|---|--------------|--|--|--|

P.F vs LOAD

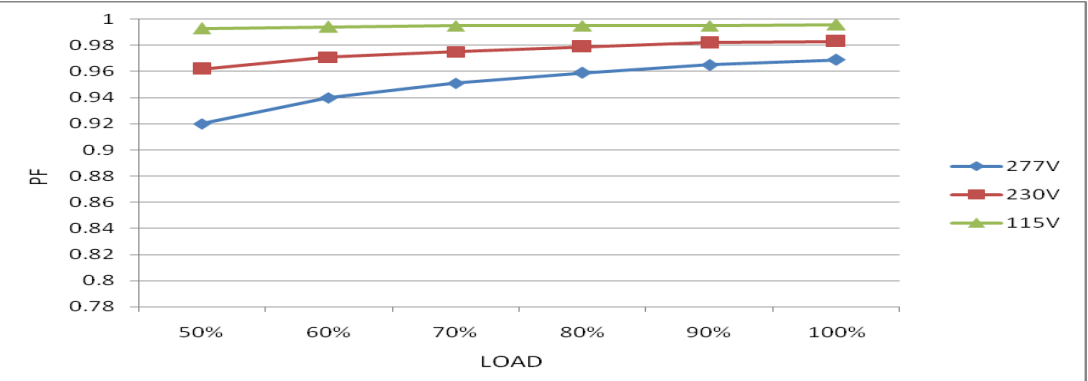

| | | | | |
|---|---------------------------|--|---|---|
| 8 | TOTAL HARMONIC DISTORTION | THD < 20% (@load ≥ 60%/115VAC, 230VAC; @load ≥ 75%/277VAC) | I/P: 115 VAC/60% LOAD I/P: 230 VAC/60% LOAD I/P: 277 VAC/75% LOAD Ta: 25°C | THD=9.32% @60% load /115VAC THD=15.19% @60% load /230VAC THD=13.66% @75% load /277VAC |
|---|---------------------------|--|---|---|

THD vs LOAD

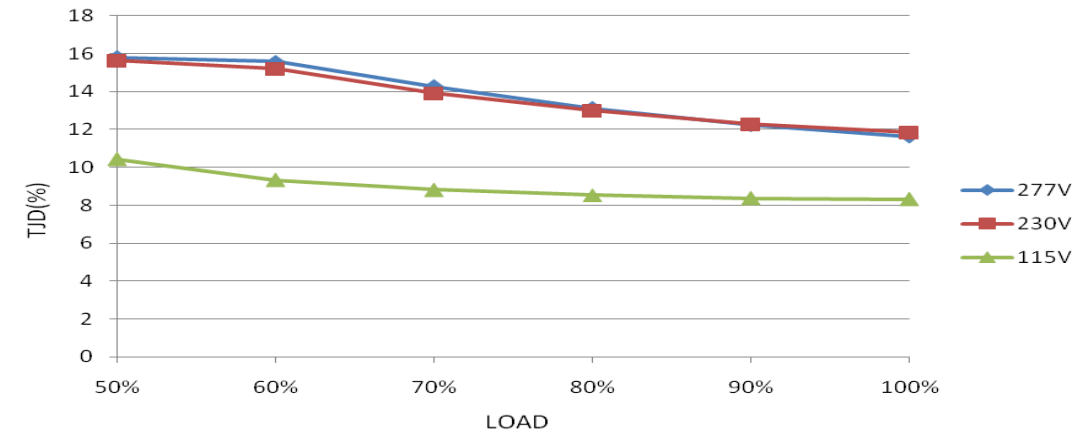

PROTECTION FUNCTION TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|-----------------------------|---------------|---|--|
| 1 | OVER LOAD PROTECTION | 95 % ~ 108 % | I/P: 100 VAC I/P: 230 VAC I/P: 305VAC O/P: TESTING Ta: 25°C | 101.25 %/100 VAC 101.26%/ 230 VAC 101.30 %/ 305VAC Constant current limiting |
| 2 | OVER VOLTAGE PROTECTION | 54V~63V | I/P: 90VAC I/P: 230VAC I/P: 305VAC O/P: NO LOAD Ta: 25°C | 58.7 V/ 90VAC 58.7V/ 230VAC 58.7V/ 305VAC Shut down o/p voltage re-power on to recovery |
| 3 | OVER TEMPERATURE PROTECTION | NO DAMAGE | I/P: 230VAC O/P: FULL LOAD | O.T.P. Active Shut down o/p voltage re-power on to recovery |

COMPONENT STRESS TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|----------------------|------------------------|---|--|
| 1 | PWM Power Transistor | Q 1 Rated 700V/12A | I/P: High-Line +3V =308V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C | (1) 598 V (2) 484 V (3) 594 V |
| 2 | O/P Diode (MOSFET) | Q101 Rated 300V/20A | I/P: High-Line +3V =308V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C | (1) 199 V (2) 155 V (3) 198 V |
| 3 | Input Capacitor | C5 Rated 82u/450V | I/P: High-Line +3V =308 V O/P: (1) FULL LOAD input on/off (2) NO LOAD input on /Off (3) FULL LOAD /NO LOAD Change Ta: 25°C | (1) 430 V (2) 422 V (3) 418 V |
| 4 | Control IC | U1 Rated 38V (MAX.) | I/P: High-Line +3V =308 V O/P: (1)Full Load Turn on /Off (2) Min load Turn on /Off (3)Full Load /Min load Change Ta: 25°C | (1) 22.4 V (2) 22.4 V (3) 22.4 V |
| 5 | PFC Power Transistor | Q 2 Rated 600V/11A | I/P: High-Line +3V =308V O/P: (1) FULL LOAD Turn on (2) Output Short (3) FULL LOAD continue Ta: 25°C | (1) 444 V (2) 428 V (3) 432 V |

SAFETY TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|----------------------|---|--|--|
| 1 | WITHSTAND VOLTAGE | I/P-O/P: 3.75KVAC/min I/P-FG: 2.0KVAC/min O/P-FG: 0.5KVAC/min | I/P-O/P: 4.2 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG: 0.6KVAC/min Ta: 25°C | I/P-O/P: 3.813 mA I/P-FG: 3.806 mA O/P-FG: 3.052 mA NO DAMAGE |
| 2 | ISOLATION RESISTANCE | I/P-O/P: 500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG: 500VDC>100MΩ | I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta: 25°C | I/P-O/P: >9999 MΩ I/P-FG: >9999 MΩ O/P-FG: >9999 MΩ |
| 3 | GROUNDING CONTINUITY | FG(PE) TO CHASSIS OR TRACE < 100 mΩ | 40 A / 2min Ta: 25°C /70% RH | 17 mΩ |


E.M.C TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT |
|----|---|---|---|-------------------------------|
| 1 | HARMONIC | EN61000-3-2 Class C | I/P: 230VAC/50HZ O/P: FULL/60% LOAD Ta: 25°C | PASS |
| 2 | CONDUCTION | EN55015 | I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C | PASS Test by certified Lab |
| 3 | RADIATION | EN55015 | I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C | PASS Test by certified Lab |
| 4 | E.S.D | EN61000-4-2 LIGHT INDUSTRY AIR: 8KV Contact: 4KV | I/P: 230 VAC/50HZ O/P: FULL LOAD Ta: 25°C | PASS |
| 5 | E.F.T | EN61000-4-4 LIGHT INDUSTRY INPUT: 1KV | I/P: 230VAC/50HZ O/P: FULL LOAD Ta: 25°C | PASS |
| 6 | SURGE | EN61000-4-5 INDUSTRY L-N: 2KV L,N-PE: 4KV | I/P: 230VAC/50HZ O/P: FULL LOAD L-N: 4KV L,N-PE: 6KV Ta: 25°C | PASS |
| 7 | Test by certified Lab & Test Report Prepare | | | |

RELIABILITY TEST

ENVIRONMENT TEST

| NO | TEST ITEM | SPECIFICATION | TEST CONDITION | RESULT | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|----|---|---|---|--|----|----------|-------------------------|-------------------------|---|-----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|----|--------|--------|---|------|--------|--------|---|------|--------|--------|---|------|--------|--------|----|----|--------|--------|
| 1 | TEMPERATURE RISE TEST | MODEL: HBG-100-60 1. ROOM AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=26.3 °C 2. HIGH AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=59.0 °C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | <table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=26.3 °C</th> <th>HIGH AMBIENT Ta=59.0 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>BD1</td><td>50.3°C</td><td>81.7°C</td></tr> <tr><td>2</td><td>C5</td><td>52.4°C</td><td>84.3°C</td></tr> <tr><td>3</td><td>Q2</td><td>57.3°C</td><td>89.8°C</td></tr> <tr><td>4</td><td>Q1</td><td>54.6°C</td><td>86.6°C</td></tr> <tr><td>5</td><td>U1</td><td>48.0°C</td><td>79.5°C</td></tr> <tr><td>6</td><td>T1</td><td>58.6°C</td><td>90.1°C</td></tr> <tr><td>7</td><td>Q101</td><td>56.5°C</td><td>87.8°C</td></tr> <tr><td>8</td><td>C106</td><td>51.9°C</td><td>83.0°C</td></tr> <tr><td>9</td><td>RTH2</td><td>47.9°C</td><td>79.1°C</td></tr> <tr><td>10</td><td>TC</td><td>43.0°C</td><td>73.8°C</td></tr> </tbody> </table> | NO | Position | ROOM AMBIENT Ta=26.3 °C | HIGH AMBIENT Ta=59.0 °C | 1 | BD1 | 50.3°C | 81.7°C | 2 | C5 | 52.4°C | 84.3°C | 3 | Q2 | 57.3°C | 89.8°C | 4 | Q1 | 54.6°C | 86.6°C | 5 | U1 | 48.0°C | 79.5°C | 6 | T1 | 58.6°C | 90.1°C | 7 | Q101 | 56.5°C | 87.8°C | 8 | C106 | 51.9°C | 83.0°C | 9 | RTH2 | 47.9°C | 79.1°C | 10 | TC | 43.0°C | 73.8°C |
| NO | Position | ROOM AMBIENT Ta=26.3 °C | HIGH AMBIENT Ta=59.0 °C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | BD1 | 50.3°C | 81.7°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | C5 | 52.4°C | 84.3°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | Q2 | 57.3°C | 89.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | Q1 | 54.6°C | 86.6°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | U1 | 48.0°C | 79.5°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | T1 | 58.6°C | 90.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | Q101 | 56.5°C | 87.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | C106 | 51.9°C | 83.0°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | RTH2 | 47.9°C | 79.1°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | TC | 43.0°C | 73.8°C | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | LOW TEMPERATURE TURN ON TEST | TURN ON AFTER 2 HOUR | I/P: 305VAC/90VAC O/P: FULL /80% LOAD Ta= -45°C /-30°C | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST | AFTER 12 HOURS IN CHAMBER ON CONTROL 60°C NO DAMAGE | I/P: 305VAC O/P: FULL LOAD Ta=60°C HUMIDITY= 95 %R.H | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | TEMPERATURE COEFFICIENT | ±0.03 %/°C (0~50°C) | I/P: 230 VAC O/P: FULL LOAD | ±0.003 %/°C (0~50°C) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | STORAGE TEMPERATURE TEST | 1. Thermal shock Temperature: -45°C ~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 5 CYCLE 5. Input/Output condition: STATIC | | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | THERMAL SHOCK TEST | 1. Thermal shock Temperature: -45°C ~ +65°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 10 CYCLE 5. Input/Output condition: 230VAC/ FULL LOAD AC ON/OFF TEST AC on 3 sec/AC off 1 sec TEST | | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | VIBRATION TEST | 1 Carton & 1 Set (1) Waveform: Sine Wave (2) Frequency: 10~500Hz (3) Sweep Time: 12min/sweep cycle (4) Acceleration: 5G (5) Test Time: 72min in each axis (X.Y.Z) (6) Ta: 25°C | | TEST: OK | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
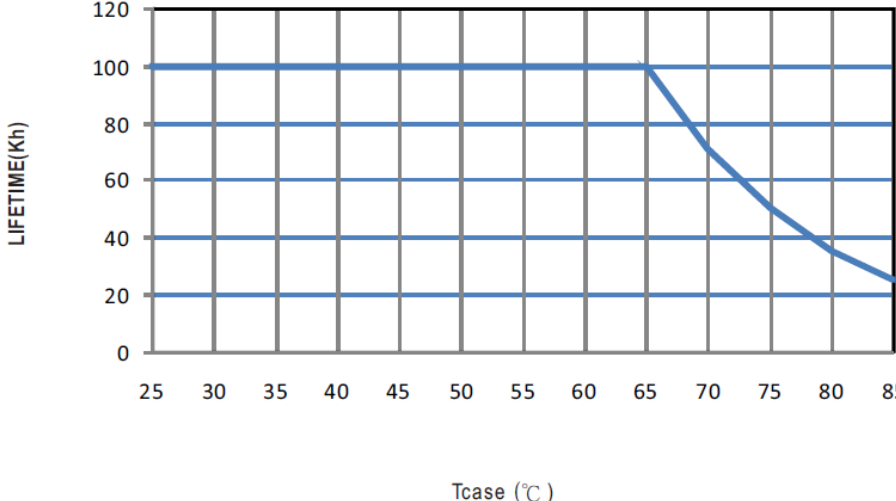
| 8 | CAPACITOR LIFE CYCLE | <p>HBG-100-60: SUPPOSE C103 IS THE MOST CRITICAL COMPONENT</p> <p>(1) I/P: 230VAC O/P: FULL LOAD Ta= 25 °C LIFE TIME</p> <p>(2) I/P: 230VAC O/P: FULL LOAD Ta= 60 °C LIFE TIME</p> <p>(3) I/P: 230VAC O/P: 75% LOAD Ta= 60 °C LIFE TIME</p> <p>(4) I/P: 230VAC O/P: MIN LOAD Ta= 60 °C LIFE TIME</p> | <p>(1) 587771 HRS</p> <p>(2) 58086 HRS</p> <p>(3) 74924 HRS</p> <p>(4) 81021 HRS</p> | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|-----------------------------|---|--|------------|---------------|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|-----|----|----|----|----|----|----|----|----|
| 9 | MTBF | <p>Conducted by Parts Stress Analysis Prediction</p> <p>2433.4K hrs min. Telcordia SR-332 (Bellcore) ; 299.3K hrs min. MIL-HDBK-217F (25°C)</p> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | DMTBF/Accelerated Life Test | <p>Demonstration Mean Time Between Failure (Expected Life):</p> <p>Above 50000 hours @ Tc 75°C</p>  <table border="1"> <caption>Approximate data points from the Lifetime vs Temperature graph</caption> <thead> <tr> <th>Tcase (°C)</th> <th>Lifetime (kh)</th> </tr> </thead> <tbody> <tr><td>25</td><td>100</td></tr> <tr><td>30</td><td>100</td></tr> <tr><td>35</td><td>100</td></tr> <tr><td>40</td><td>100</td></tr> <tr><td>45</td><td>100</td></tr> <tr><td>50</td><td>100</td></tr> <tr><td>55</td><td>100</td></tr> <tr><td>60</td><td>100</td></tr> <tr><td>65</td><td>100</td></tr> <tr><td>70</td><td>70</td></tr> <tr><td>75</td><td>45</td></tr> <tr><td>80</td><td>30</td></tr> <tr><td>85</td><td>25</td></tr> </tbody> </table> | | Tcase (°C) | Lifetime (kh) | 25 | 100 | 30 | 100 | 35 | 100 | 40 | 100 | 45 | 100 | 50 | 100 | 55 | 100 | 60 | 100 | 65 | 100 | 70 | 70 | 75 | 45 | 80 | 30 | 85 | 25 |
| Tcase (°C) | Lifetime (kh) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 25 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 30 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 35 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 40 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 45 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 50 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 55 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 60 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 65 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 70 | 70 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 75 | 45 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 80 | 30 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 85 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| TEST RESULT | TESTER | REVIEW | APPROVAL |
|-------------|---------------|--------|----------|
| PASS | SHENJW/ZHUOKB | SKY | LIUWY |